



# 2" METER POSTS

## FRONT VIEW

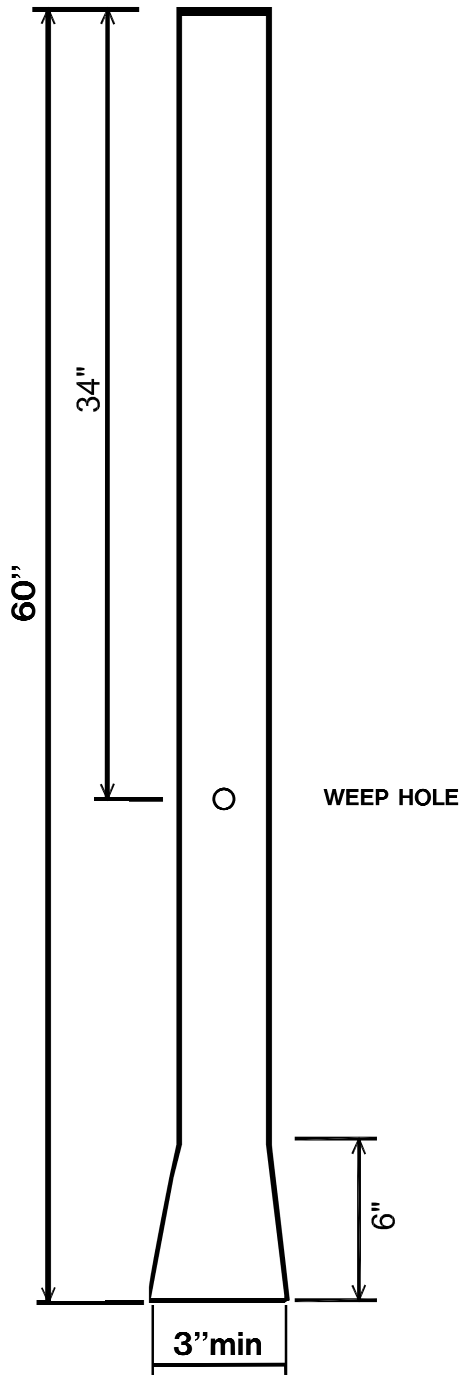

## SIDE VIEW

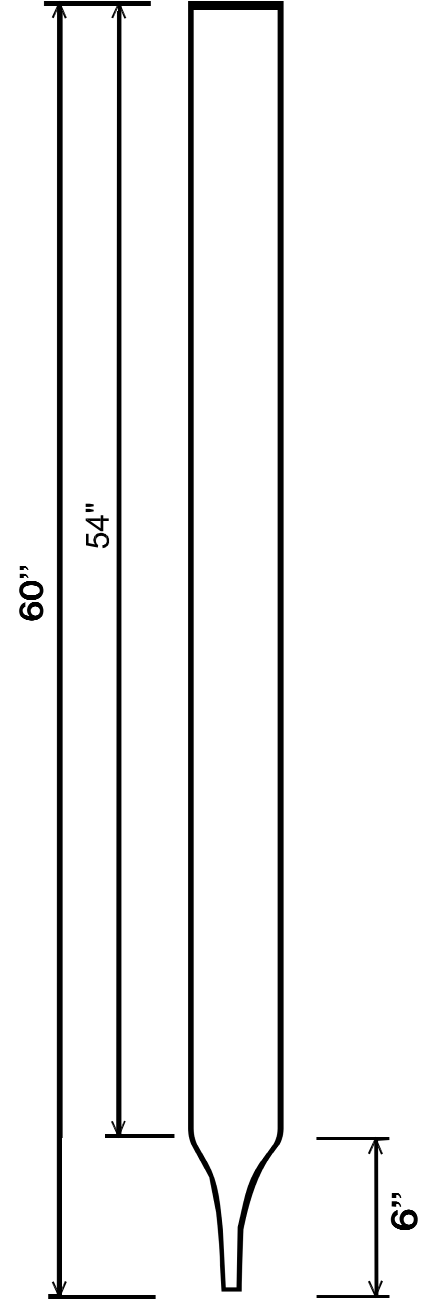

### NOTES:

1. Meter posts to be Schedule 40 Standard Steel Pipe 2" inside diameter.
2. The bottom 6" of each post shall be deformed to provide for anti-rotation.
3. Post to be drilled with  $\frac{5}{8}$ " hole in one wall for drainage.

A107

Not to Scale

REV: NOV. 14, 2014

DATE: SEPT. 23, 1993